1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

Sound Absorption RAL-A18-433

Page 1 of 9

FOR: Turf Design Elgin, IL

CONDUCTED: 2018-12-06

ON: Carve baffles, spaced 12 in. on center

TEST METHOD

Riverbank Acoustical LaboratoriesTM is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as Carve baffles, spaced 12 in. on center. A full internal inspection performed on the test specimen by Riverbank personnel verified the manufacturer's description.

Specimen

Trade Name: Carve

Material: Polyethylene terephthalate felt

Overall Dimensions: 10 @ 2387.6 mm (94 in.) long x 28.96 mm (1.14 in.) wide x 241.3

mm (9.5 in.) high

Key Geometry: 9 mm (0.354 in.) thick felt body with 2.5 mm (0.098 in.) deep ridge

patterns on both sides

Concentration and orientation of ridge pattern varies between baffles Additional 54 mm (2.126 in.) wide x 9 mm (0.354 in.) thick felt

pieces adhered to both sides of body at top edge

Overall Weight: 13.38 kg (29.5 lbs)

Physical Measures (per unit)

Dimensions: 0.24 m (9.5 in) wide by 2.39 m (94.0 in) long

Thickness: 0.03 m (1.14 in) Weight: 1.34 kg (2.95 lbs)



1512 S BATAVIA AVENUE GENEVA. IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Turf Design 2018-12-06

RAL-A18-433 Page 2 of 9

Test Environment

Room Volume: 291.98 m³


Temperature: $20.3 \, ^{\circ}\text{C} \pm 0.0 \, ^{\circ}\text{C}$ Relative Humidity: $61.45 \% \pm 0.3 \%$

Barometric Pressure: 99.8 kPa

Each sound absorbing unit had an average absorptive area (all exposed surfaces) of 2.00 m² (21.53 ft²). The total absorptive area (all exposed surfaces) of all sound-absorbing units was 20.00 m² (215.28 ft²). The array of units covered 6.66 m² (71.64 ft²) of chamber floor surface (total treated area).

MOUNTING METHOD

Type J Mounting: The specimen is an array of ten (10) spaced sound absorbing baffles suspended from an array of cables such that the bottom face of the baffles is located approximately 1193.8 mm (47 in.) above the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The baffles were evenly distributed in a single row, spaced 304.8 mm (12 in.) on center.



1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RAL-A18-433 Page 3 of 9

Turf Design 2018-12-06



Figure 1 - Specimen mounted in test chamber

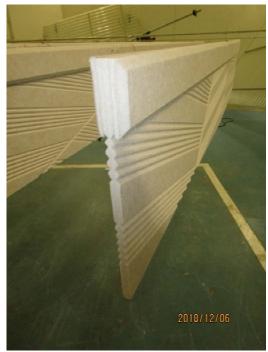


Figure 2 - Detail of individual baffle



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2005 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

Turf Design 2018-12-06

RAL-A18-433 Page 4 of 9

TEST RESULTS

Note: There is currently no standardized method for calculating Absorption Coefficients from spaced object absorbers. The sound absorption performance of spaced object absorbers should not be compared directly with specimens tested as a single rectangular area (e.g. mounting types A, E, etc.).

1/3 Octave Center Frequency	Total A	bsorption	Absorpti	on per Unit
(Hz)	(m^2)	(Sabins)	$(m^2/Unit)$	(Sabins / Unit)
100	0.64	6.91	0.06	0.69
** 125	0.23	2.45	0.02	0.24
160	0.95	10.21	0.09	1.02
200	1.15	12.38	0.12	1.24
** 250	1.84	19.81	0.18	1.98
315	2.22	23.94	0.22	2.39
400	2.61	28.13	0.26	2.81
** 500	3.02	32.52	0.30	3.25
630	3.20	34.49	0.32	3.45
800	3.46	37.19	0.35	3.72
** 1000	4.31	46.38	0.43	4.64
1250	5.04	54.29	0.50	5.43
1600	5.97	64.25	0.60	6.42
** 2000	6.92	74.45	0.69	7.44
2500	7.55	81.22	0.75	8.12
3150	7.97	85.74	0.80	8.57
** 4000	8.40	90.45	0.84	9.05
5000	8.59	92.47	0.86	9.25

Tested by Marc Sciaky

Report by _

Malcolm Kelly

Approved by

Eric P. Wolfram

Experimentalist

Acoustical Test Engineer

Laboratory Manager



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2005 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report


RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RAL-A18-433 Page 5 of 9

Turf Design 2018-12-06

SOUND ABSORPTION REPORT

Carve baffles, spaced 12 in. on center

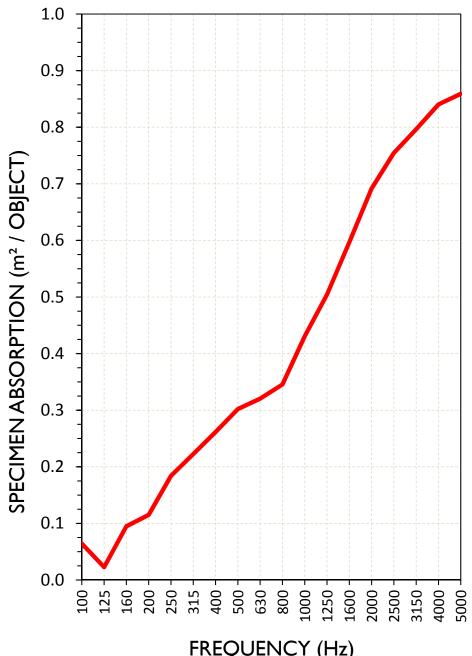

FREQUENCY (Hz)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2005 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report


Turf Design RAL-A18-433 2018-12-06 Page 6 of 9

APPENDIX A: Extended Frequency Range Data

Specimen: Carve baffles, spaced 12 in. on center (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency	Total Absorption		Absorption per Unit		
(Hz)	(m^2)	(Sabins)	(m ² /Unit)	(Sabins / Unit)	
31.5	-0.89	-9.59	-0.09	-0.96	
40	0.68	7.27	0.07	0.73	
50	-0.28	-3.00	-0.03	-0.30	
63	-0.12	-1.30	-0.01	-0.13	
80	0.41	4.42	0.04	0.44	
100	0.64	6.91	0.06	0.69	
125	0.23	2.45	0.02	0.24	
160	0.95	10.21	0.09	1.02	
200	1.15	12.38	0.12	1.24	
250	1.84	19.81	0.18	1.98	
315	2.22	23.94	0.22	2.39	
400	2.61	28.13	0.26	2.81	
500	3.02	32.52	0.30	3.25	
630	3.20	34.49	0.32	3.45	
800	3.46	37.19	0.35	3.72	
1000	4.31	46.38	0.43	4.64	
1250	5.04	54.29	0.50	5.43	
1600	5.97	64.25	0.60	6.42	
2000	6.92	74.45	0.69	7.44	
2500	7.55	81.22	0.75	8.12	
3150	7.97	85.74	0.80	8.57	
4000	8.40	90.45	0.84	9.05	
5000	8.59	92.47	0.86	9.25	
6300	8.52	91.68	0.85	9.17	
8000	8.46	91.09	0.85	9.11	
10000	8.73	93.95	0.87	9.39	
12500	8.38	90.25	0.84	9.02	



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NYLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2005 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

Turf Design2018-12-06 **RAL-A18-433**Page 7 of 9

APPENDIX B: Instruments of Traceability

Specimen: Carve baffles, spaced 12 in. on center (See Full Report)

		Serial	Date of	Calibration
Description	Model	<u>Number</u>	Certification	<u>Due</u>
System 1	Type 3160-A-4/2	System 1	2018-08-09	2019-08-09
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2018-09-28	2019-09-28
Bruel & Kjaer Pistonphone	Type 4228	2781248	2018-08-06	2019-08-06
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	P97844	2018-02-03	2019-02-03

END





Riverbank Acoustical Laboratories 1512 S. Batavia Ave. Geneva, IL 60134-3302

Tel: 630-232-0104 Fax: 630-232-0138

Email: RAL@alionscience.com

FOR: **Turf Design** Report Referenced: **RAL-A18-433**

Elgin, IL Page 1 of 2

CONDUCTED: 2018-12-06

ON: Carve baffles, spaced 12 in. on center (See Full Test Report for Details)

Appendix C to ASTM C423 Sound Absorption Test

Non-standard calculation of equivalent NRC Rating and Absorption Coefficients from spaced absorbers.

At this time ASTM C423 does not provide a standard method for determining absorption coefficients of spaced object absorbers. Tests of a set of sound absorbing objects spaced apart from each other will yield higher absorption rates than a specimen joined together as a single patch (A-Mount or E-Mount). For this reason it is unfair to provide NRC or absorption coefficient ratings for specimens that consist of a spaced set of absorbers. Despite this, the architectural industry has expressed great demand for a simple "single number" rating for these treatments. Likewise, acoustical consultants desire equivalent absorption coefficient data for use in acoustical modeling programs. The following is an attempt to appease these demands until ASTM develops a standard method for calculation. Several alternate non-standard calculation methods are provided. Riverbank Acoustical Laboratories prefers method 1.

Method 1) Apparent Sound Absorption Coefficient calculated from total test surface area covered.

The total sound absorption yielded by the specimen is divided by the total surface area of the test surface covered by the suspended baffles, including intermediate spaces. The baffle rigging covered 6.66 m² (71.64 ft²) of horizontal test surface area. With an additional 304.8 mm (12 in.) of width to account for the space between the tested array and what would be the next baffle in a larger array, the surface area comes to 7.38 m² (79.48 ft²). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This may be the most accurate method for comparing baffle arrays to ceiling tile products. In acoustical modeling applications, the apparent sound absorption coefficient data can be assigned to a single horizontal surface or plane for approximation of baffle array performance. Such approximations rely on the assumptions that baffle spacing is similar to the tested specimen and that the installation occurs over a perfectly reflective ceiling surface.

Method 2) Apparent Sound Absorption Coefficient calculated from total exposed surface area of specimen.

The total sound absorption yielded by the specimen is divided by the total surface area of all exposed specimen faces, as obtained from client CAD models (2.00 m² (21.53 ft²) per baffle x 10 baffles = 20.00 m² (215.28 ft²) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method shows the actual absorption occurring at the exposed surfaces, but does not provide a fair comparison with materials mounted as a uniform patch (in A-mount or E-mount).

Method 3) Apparent Sound Absorption Coefficient calculated from one face per baffle.

The total sound absorption yielded by the specimen is divided by the surface area of one side of one large face for each baffle in the specimen (0.58 m² (6.20 ft²) per baffle x 10 baffles = 5.76 m² (62.01 ft²) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method is favored by some material manufacturers since it yields very high NRC figures, but does not provide a fair comparison with other ceiling tile or wall panel products. Riverbank Acoustical Laboratories recommends that results obtained from this method be used for research and comparison purposes only; such results should not be used for marketed claims of product performance.



An A LION Technical Center

Riverbank Acoustical Laboratories 1512 S. Batavia Ave. Geneva, IL 60134-3302

Tel: 630-232-0104 Fax: 630-232-0138

Email: RAL@alionscience.com

FOR: **Turf Design**CONDUCTED: 2018-12-06

Report Referenced: RAL-A18-433
Page 2 of 2

Appendix D: Data Note: See full test report for details of mounting position, spacing and configuration as these parameters greatly affect sound absorption performance.

			Method 1	Method 2	Method 3
	Specimen Abso	orption	Apparent	Apparent	Apparent
			Abs. Coefficient	Abs. Coefficient	Abs. Coefficient
Freq.	~	a	From Total	From Total	From One
(Hz)	Sabins	Sabins / Unit	Coverage Area	Exposed Surface Area	Face/Baffle
31.5	-9.59	-0.96	-0.12	-0.04	-0.15
40	7.27	0.73	0.09	0.03	0.12
50	-3.00	-0.30	-0.04	-0.01	-0.05
63	-1.30	-0.13	-0.02	-0.01	-0.02
80	4.42	0.44	0.06	0.02	0.07
100	6.91	0.69	0.09	0.03	0.11
125	2.45	0.24	0.03	0.01	0.04
160	10.21	1.02	0.13	0.05	0.16
200	12.38	1.24	0.16	0.06	0.20
250	19.81	1.98	0.25	0.09	0.32
315	23.94	2.39	0.30	0.11	0.39
400	28.13	2.81	0.35	0.13	0.45
500	32.52	3.25	0.41	0.15	0.52
630	34.49	3.45	0.43	0.16	0.56
800	37.19	3.72	0.47	0.17	0.60
1,000	46.38	4.64	0.58	0.22	0.75
1,250	54.29	5.43	0.68	0.25	0.88
1,600	64.25	6.42	0.81	0.30	1.04
2,000	74.45	7.44	0.94	0.35	1.20
2,500	81.22	8.12	1.02	0.38	1.31
3,150	85.74	8.57	1.08	0.40	1.38
4,000	90.45	9.05	1.14	0.42	1.46
5,000	92.47	9.25	1.16	0.43	1.49
6,300	91.68	9.17	1.15	0.43	1.48
8,000	91.09	9.11	1.15	0.42	1.47
10,000	93.95	9.39	1.18	0.44	1.51
12,500	90.25	9.02	1.14	0.42	1.46
		Apparent NRC:	0.55	0.20	0.70
		Apparent SAA:	0.53	0.20	0.68

Prepared by_

Malcolm Kelly

Acoustical Test Engineer