1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

SPONSOR: TURF

Elgin, IL

Sound Absorption RAL<sup>TM</sup>-A20-245

CONDUCTED: 2020-06-25

Page 1 of 10

ON: BEAM baffle (8 units spaced 12 in. apart)

#### TEST METHODOLOGY

Riverbank Acoustical Laboratories<sup>TM</sup> is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

#### INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as BEAM baffle (8 units spaced 12 in. apart). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

#### **Product Under Test**

Trade Name: BEAM

Material: Polyethylene terephthalate felt

Manufacturer: TURF

#### SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

#### **Test Specimen**

Material: Notched and folded semirigid felt paneling

Dimensions: 8 @ 2495.55 mm (98.25 in.) long x 203.2 mm (8 in.) deep

Thickness: 76.2 mm (3 in.) Overall Weight: 21.43 kg (47.25 lbs)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

**TURF** 2020-06-25

RAL<sup>TM</sup>-A20-245 Page 2 of 10

#### Physical Measurements (per unit)

Dimensions: 0.2 m (7.872 in) wide by 2.5 m (98.424 in) long

Thickness: 0.08 m (3.144 in) Weight: 2.68 kg (5.9 lbs)

## **Test Environment**

Room Volume: 291.98 m<sup>3</sup>

Temperature:  $22.4~^{\circ}\text{C} \pm 0.3~^{\circ}\text{C}$  (Requirement:  $\geq 10~^{\circ}\text{C}$  and  $\leq 5~^{\circ}\text{C}$  change) Relative Humidity:  $59.85~\% \pm 0.1~\%$  (Requirement:  $\geq 40~\%$  and  $\leq 5~\%$  change)

Barometric Pressure: 98.6 kPa (Requirement not defined)

Each sound absorbing unit had an absorptive area (all exposed surfaces) of 1.43 m<sup>2</sup> (15.34 ft<sup>2</sup>). The total absorptive area (all exposed surfaces) of all sound-absorbing units was 11.40 m<sup>2</sup> (122.75 ft<sup>2</sup>). The array of units covered 6.88 m<sup>2</sup> (74.03 ft<sup>2</sup>) of the horizontal test surface (total treated area).

#### **MOUNTING METHOD**

Type J Mounting: The specimen is an array of 8 spaced sound absorbing baffles suspended from cables such that the closest face of the baffles is located approximately 1295.4 mm (51 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The baffles were evenly distributed in a single row, spaced 304.8 mm (12 in.) apart.



1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RAL<sup>TM</sup>-A20-245 Page 3 of 10

**TURF** 2020-06-25



Figure 1 – Specimen mounted in test chamber

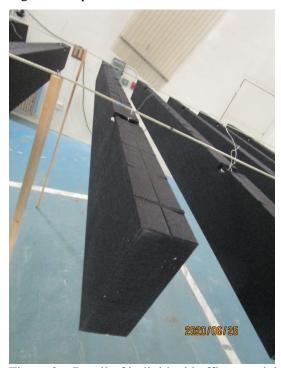


Figure 2 – Detail of individual baffle material



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RAL<sup>TM</sup>-A20-245 Page 4 of 10

**TURF** 2020-06-25



Figure 3 – Underside of installed specimen

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

TURF 2020-06-25 Page 5 of 10

#### TEST RESULTS

Note: There is currently no standardized method for calculating Absorption Coefficients from spaced object absorbers. The sound absorption performance of spaced object absorbers should not be compared directly with specimens tested as a single rectangular area (e.g. mounting types A, E, etc.).

1/3 Octave Center Frequency	Total Absorption		Absorption per Unit		
(Hz)	$(m^2)$	(Sabins)	(m <sup>2</sup> /Unit)	(Sabins / Unit)	
100	1.08	11.58	0.13	1.45	
** 125	1.31	14.10	0.16	1.76	
160	1.08	11.64	0.14	1.45	
200	1.79	19.26	0.22	2.41	
** 250	2.51	27.03	0.31	3.38	
315	3.68	39.64	0.46	4.96	
400	4.22	45.44	0.53	5.68	
** 500	4.97	53.53	0.62	6.69	
630	5.88	63.25	0.73	7.91	
800	6.55	70.45	0.82	8.81	
** 1000	7.38	79.48	0.92	9.94	
1250	8.53	91.79	1.07	11.47	
1600	9.20	99.06	1.15	12.38	
** 2000	9.51	102.33	1.19	12.79	
2500	9.84	105.88	1.23	13.24	
3150	10.04	108.09	1.26	13.51	
** 4000	10.48	112.82	1.31	14.10	
5000	10.40	111.90	1.30	13.99	

Tested by Marc Sciaky

Senior Experimentalist

Report by

Malcolm Kelly

Test Engineer, Acoustician

Approved by

Eric P. Wolfram

Laboratory Manager



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE


Test Report

RAL<sup>TM</sup>-A20-245 Page 6 of 10

**TURF** 2020-06-25

#### **SOUND ABSORPTION REPORT**

BEAM baffle (8 units spaced 12 in. apart)

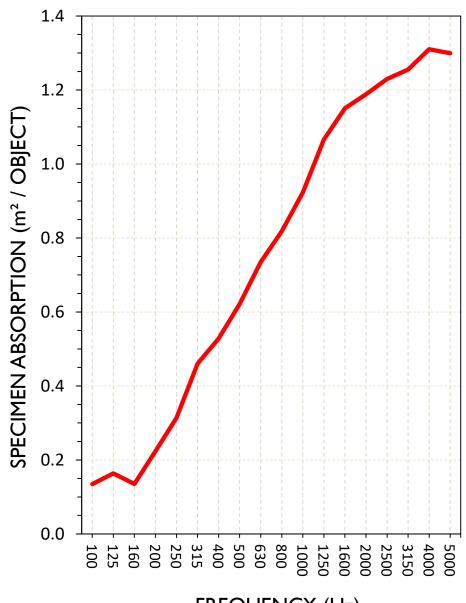

FREQUENCY (Hz)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

**TURF** 2020-06-25

RAL<sup>TM</sup>-A20-245
Page 7 of 10

#### **APPENDIX A: Extended Frequency Range Data**

Specimen: BEAM baffle (8 units spaced 12 in. apart) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency	<b>Total Absorption</b>		<b>Absorption per Unit</b>		
(Hz)	$(m^2)$	(Sabins)	(m <sup>2</sup> /Unit)	(Sabins / Unit)	
31.5	0.17	1.84	0.02	0.23	
40	-0.11	-1.14	-0.01	-0.14	
50	0.29	3.15	0.04	0.39	
63	0.44	4.77	0.06	0.60	
80	-0.03	-0.27	0.00	-0.03	
100	1.08	11.58	0.13	1.45	
125	1.31	14.10	0.16	1.76	
160	1.08	11.64	0.14	1.45	
200	1.79	19.26	0.22	2.41	
250	2.51	27.03	0.31	3.38	
315	3.68	39.64	0.46	4.96	
400	4.22	45.44	0.53	5.68	
500	4.97	53.53	0.62	6.69	
630	5.88	63.25	0.73	7.91	
800	6.55	70.45	0.82	8.81	
1000	7.38	79.48	0.92	9.94	
1250	8.53	91.79	1.07	11.47	
1600	9.20	99.06	1.15	12.38	
2000	9.51	102.33	1.19	12.79	
2500	9.84	105.88	1.23	13.24	
3150	10.04	108.09	1.26	13.51	
4000	10.48	112.82	1.31	14.10	
5000	10.40	111.90	1.30	13.99	
6300	10.34	111.30	1.29	13.91	
8000	10.43	112.24	1.30	14.03	
10000	10.31	110.94	1.29	13.87	
12500	10.31	111.01	1.29	13.88	



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

TURF 2020-06-25 RAL<sup>TM</sup>-A20-245 Page 8 of 10

#### **APPENDIX B: Instruments of Traceability**

Specimen: BEAM baffle (8 units spaced 12 in. apart) (See Full Report)

		Serial	Date of	Calibration
<b>Description</b>	<b>Model</b>	<u>Number</u>	<b>Certification</b>	<b>Due</b>
System 2	Type 3160-A-042	3160- 106974	2019-08-08	2020-08-08
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2019-09-27	2020-09-27
Bruel & Kjaer Pistonphone	Type 4228	2781248	2019-08-09	2020-08-09
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	P97844	2020-02-18	2021-02-18

## **APPENDIX C: Revisions to Original Test Report**

Specimen: BEAM baffle (8 units spaced 12 in. apart) (See Full Report)

<u>Date</u>	<u>Revision</u>		
2020-06-30	Original report issued		







Riverbank Acoustical Laboratories 1512 S. Batavia Ave. Geneva, IL 60134-3302

Tel: 630-232-0104 Fax: 630-232-0138

Email: RAL@alionscience.com

SPONSOR: TURF Report Referenced: RAL<sup>TM</sup>-A20-245

Elgin, IL Page 1 of 2

CONDUCTED: 2020-06-25

ON: BEAM baffle (8 units spaced 12 in. apart) (See Full Test Report for Details)

#### Appendix D to ASTM C423 Sound Absorption Test

Non-standard calculation of equivalent NRC Rating and Absorption Coefficients from spaced absorbers

At this time ASTM C423 does not provide a standard method for determining absorption coefficients of spaced object absorbers. Tests of a set of sound absorbing objects spaced apart from each other will yield higher absorption rates than a specimen joined together as a single patch (A-Mount or E-Mount). For this reason it is unfair to provide NRC or absorption coefficient ratings for specimens that consist of a spaced set of absorbers. Despite this, the architectural industry has expressed great demand for a simple "single number" rating for these treatments. Likewise, acoustical consultants desire equivalent absorption coefficient data for use in acoustical modeling software. The following is an attempt to appease these demands until ASTM develops a standard method for calculation. Several alternate non-standard calculation methods are provided. Riverbank Acoustical Laboratories prefers method 1.

#### Method 1) Apparent Sound Absorption Coefficient calculated from total test surface area covered

The total sound absorption yielded by the specimen is divided by the total surface area of the test surface covered by the suspended baffles, including intermediate spaces. The baffle rigging covered 6.88 m² (74.03 ft²) of horizontal test surface area. With an extra 304.8 mm (12 in.) of width to account for the space between the tested array and what would be the next baffle in a larger array, the surface area comes to 7.64 m² (82.22 ft²) Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This may be the most accurate method for comparing baffle arrays to ceiling tile products. The apparent sound absorption coefficient data can be assigned to a single horizontal surface or plane in acoustical modeling software for approximation of baffle array performance. Such approximations rely on the assumptions that baffle spacing is similar to that of the tested array across the entire surface, that the space between adjacent rows of baffles is negligibly small, and that the installation occurs over a perfectly reflective surface material.

# **Method 2)** Apparent Sound Absorption Coefficient calculated from total exposed surface area of specimen The total sound absorption yielded by the specimen is divided by the total surface area of all exposed specimen faces (1.43 m² (15.34 ft²) per baffle x 8 baffles = 11.40 m² (122.75 ft²) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method shows the actual absorption occurring at the exposed surfaces, but does not provide a fair comparison with materials mounted as a uniform patch (in A-mount or E-mount).

#### Method 3) Apparent Sound Absorption Coefficient calculated from one face per baffle

The total sound absorption yielded by the specimen is divided by the surface area of one side of one large face for each baffle in the specimen (0.51 m² (5.46 ft²) per baffle x 8 baffles = 4.06 m² (43.67 ft²) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method is favored by some material manufacturers since it yields very high NRC figures, but does not provide a fair comparison with other ceiling tile or wall panel products. Riverbank Acoustical Laboratories recommends that results obtained from this method be used for research and comparison purposes only; such results should not be used for marketed claims of product performance.



An A LION Technical Center

Riverbank Acoustical Laboratories 1512 S. Batavia Ave. Geneva, IL 60134-3302

Tel: 630-232-0104 Fax: 630-232-0138

Email: RAL@alionscience.com

Report Referenced: <u>RAL<sup>TM</sup>-A20-245</u> SPONSOR: TURF CONDUCTED: 2020-06-25

Note: See full test report for details of mounting position, spacing, and configuration, as Appendix D: Data these parameters greatly affect sound absorption performance.

			Method 1	Method 2	Method 3
Specimen Absorption		Apparent	Apparent	Apparent	
		Abs. Coefficient	Abs. Coefficient	Abs. Coefficient	
Freq.			From Total	From Total	From One
(Hz)	Sabins	Sabins / Unit	Coverage Area	Exposed Surface	Face/Baffle
21.5	1.84	0.23	0.02	Area 0.02	0.04
31.5			0.02		
40	-1.14	-0.14	-0.01	-0.01	-0.03
50	3.15	0.39	0.04	0.03	0.07
63	4.77	0.60	0.06	0.04	0.11
80	-0.27	-0.03	0.00	0.00	-0.01
100	11.58	1.45	0.14	0.09	0.27
125	14.10	1.76	0.17	0.11	0.32
160	11.64	1.45	0.14	0.09	0.27
200	19.26	2.41	0.23	0.16	0.44
250	27.03	3.38	0.33	0.22	0.62
315	39.64	4.96	0.48	0.32	0.91
400	45.44	5.68	0.55	0.37	1.04
500	53.53	6.69	0.65	0.44	1.23
630	63.25	7.91	0.77	0.52	1.45
800	70.45	8.81	0.86	0.57	1.61
1,000	79.48	9.94	0.97	0.65	1.82
1,250	91.79	11.47	1.12	0.75	2.10
1,600	99.06	12.38	1.20	0.81	2.27
2,000	102.33	12.79	1.24	0.83	2.34
2,500	105.88	13.24	1.29	0.86	2.42
3,150	108.09	13.51	1.31	0.88	2.48
4,000	112.82	14.10	1.37	0.92	2.58
5,000	111.90	13.99	1.36	0.91	2.56
6,300	111.30	13.91	1.35	0.91	2.55
8,000	112.24	14.03	1.37	0.91	2.57
10,000	110.94	13.87	1.35	0.90	2.54
12,500	111.01	13.88	1.35	0.90	2.54
12,500	111.01	Apparent NRC:	0.80	0.55	1.50
		Apparent NAC: Apparent SAA:	0.81	0.54	1.52

Prepared by\_

Malcolm Kelly

Test Engineer, Acoustician