1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

SPONSOR: TURF

Elgin, IL

Sound Absorption RALTM-A20-256

CONDUCTED: 2020-06-26

Page 1 of 9

ON: TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart)

TEST METHODOLOGY

Riverbank Acoustical LaboratoriesTM is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Trade Name: TIMBER

Material: Polyethylene terephthalate felt

Manufacturer: TURF

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Material: Notched and folded semirigid felt paneling

Dimensions: 10 @ 2438.4 mm (96 in.) long x 292.1 mm (11.5 in.) deep

Thickness: 19.05 mm (0.75 in.)

Overall Weight: 27.67 kg (61 lbs)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

RALTM-A20-256 Page 2 of 9

TURF 2020-06-26

Physical Measurements (per unit)

Dimensions: 0.29 m (11.5 in) wide by 2.44 m (96.0 in) long

Thickness: 0.02 m (0.75 in) Weight: 2.77 kg (6.1 lbs)

Test Environment

Room Volume: 291.98 m³

Temperature: $22.3 \, ^{\circ}\text{C} \pm 0.3 \, ^{\circ}\text{C}$ (Requirement: $\geq 10 \, ^{\circ}\text{C}$ and $\leq 5 \, ^{\circ}\text{C}$ change) Relative Humidity: $59.55 \, \% \pm 0.1 \, \%$ (Requirement: $\geq 40 \, \%$ and $\leq 5 \, \%$ change)

Barometric Pressure: 98.3 kPa (Requirement not defined)

Each sound absorbing unit had an absorptive area (all exposed surfaces) of 1.53 m^2 (16.45 ft^2). The total absorptive area (all exposed surfaces) of all sound-absorbing units was 15.29 m^2 (164.53 ft^2). The array of units covered 7.14 m^2 (76.83 ft^2) of the horizontal test surface (total treated area).

MOUNTING METHOD

Type J Mounting: The specimen is an array of 10 spaced sound absorbing baffles suspended from cables such that the closest face of the baffles is located approximately 1244.6 mm (49 in.) from the horizontal test surface. This approximates the mounting method of a typical ceiling baffle installation. The baffles were evenly distributed in a single row, spaced 304.8 mm (12 in.) apart.



An MALION Technical Center

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RALTM-A20-256 Page 3 of 9

TURF 2020-06-26



Figure 1 – Specimen mounted in test chamber

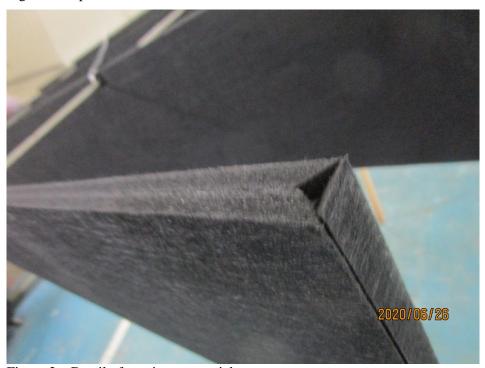


Figure 2 – Detail of specimen material



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

TURF 2020-06-26

RALTM-A20-256
Page 4 of 9

TEST RESULTS

Note: There is currently no standardized method for calculating Absorption Coefficients from spaced object absorbers. The sound absorption performance of spaced object absorbers should not be compared directly with specimens tested as a single rectangular area (e.g. mounting types A, E, etc.).

1/3 Octave Center Frequency	Total Absorption		Absorption per Unit		
(Hz)	(m^2)	(Sabins)	(m ² /Unit)	(Sabins / Unit)	
100	0.41	4.44	0.04	0.44	
** 125	0.37	4.03	0.04	0.40	
160	0.01	0.08	0.00	0.01	
200	0.09	0.99	0.01	0.10	
** 250	0.33	3.54	0.03	0.35	
315	0.89	9.59	0.09	0.96	
400	1.16	12.50	0.12	1.25	
** 500	1.42	15.30	0.14	1.53	
630	2.41	25.93	0.24	2.59	
800	3.54	38.13	0.35	3.81	
** 1000	5.21	56.04	0.52	5.60	
1250	7.76	83.55	0.78	8.36	
1600	9.54	102.69	0.95	10.27	
** 2000	11.07	119.16	1.11	11.92	
2500	11.85	127.57	1.19	12.76	
3150	11.68	125.76	1.17	12.58	
** 4000	11.64	125.31	1.16	12.53	
5000	11.61	124.97	1.16	12.50	

Tested by //o

Marc Sciaky

Senior Experimentalist

Report by

Malcolm Kelly

Test Engineer, Acoustician

Approved by

Eric P. Wolfram

Laboratory Manager



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center


RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

TURF 2020-06-26 RALTM-A20-256 Page 5 of 9

SOUND ABSORPTION REPORT

TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart)

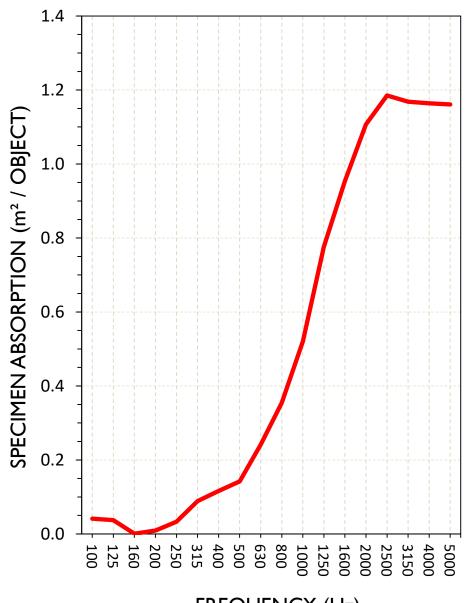

FREQUENCY (Hz)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report


TURF 2020-06-26 RALTM-A20-256 Page 6 of 9

APPENDIX A: Extended Frequency Range Data

Specimen: TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency	Total Absorption		Absorption per Unit		
(Hz)	(m^2)	(Sabins)	(m ² /Unit)	(Sabins / Unit)	
31.5	0.35	3.75	0.03	0.37	
40	-0.09	-0.98	-0.01	-0.10	
50	0.08	0.89	0.01	0.09	
63	0.40	4.30	0.04	0.43	
80	0.22	2.35	0.02	0.23	
100	0.41	4.44	0.04	0.44	
125	0.37	4.03	0.04	0.40	
160	0.01	0.08	0.00	0.01	
200	0.09	0.99	0.01	0.10	
250	0.33	3.54	0.03	0.35	
315	0.89	9.59	0.09	0.96	
400	1.16	12.50	0.12	1.25	
500	1.42	15.30	0.14	1.53	
630	2.41	25.93	0.24	2.59	
800	3.54	38.13	0.35	3.81	
1000	5.21	56.04	0.52	5.60	
1250	7.76	83.55	0.78	8.36	
1600	9.54	102.69	0.95	10.27	
2000	11.07	119.16	1.11	11.92	
2500	11.85	127.57	1.19	12.76	
3150	11.68	125.76	1.17	12.58	
4000	11.64	125.31	1.16	12.53	
5000	11.61	124.97	1.16	12.50	
6300	11.29	121.56	1.13	12.16	
8000	11.06	119.09	1.11	11.91	
10000	10.94	117.80	1.09	11.78	
12500	10.66	114.78	1.07	11.48	



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NYLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

Test Report

TURF 2020-06-26 RALTM-A20-256 Page 7 of 9

APPENDIX B: Instruments of Traceability

Specimen: TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart) (See Full Report)

		Serial	Date of	Calibration
Description	Model	<u>Number</u>	Certification	Due
System 2	Type 3160-A-042	3160- 106974	2019-08-08	2020-08-08
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2019-09-27	2020-09-27
Bruel & Kjaer Pistonphone	Type 4228	2781248	2019-08-09	2020-08-09
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	P97844	2020-02-18	2021-02-18

APPENDIX C: Revisions to Original Test Report

Specimen: TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart) (See Full Report)

<u>Date</u>	<u>Revision</u>		
2020-06-30	Original report issued		





SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.



Riverbank Acoustical Laboratories 1512 S. Batavia Ave. Geneva, IL 60134-3302

Tel: 630-232-0104 Fax: 630-232-0138

Email: RAL@alionscience.com

SPONSOR: TURF Report Referenced: RALTM-A20-256

Elgin, IL Page 1 of 2

CONDUCTED: 2020-06-26

ON: TIMBER baffles, 11.5 in. depth (10 units, spaced 12 in. apart) (See Full Test Report for Details)

Appendix D to ASTM C423 Sound Absorption Test

Non-standard calculation of equivalent NRC Rating and Absorption Coefficients from spaced absorbers

At this time ASTM C423 does not provide a standard method for determining absorption coefficients of spaced object absorbers. Tests of a set of sound absorbing objects spaced apart from each other will yield higher absorption rates than a specimen joined together as a single patch (A-Mount or E-Mount). For this reason it is unfair to provide NRC or absorption coefficient ratings for specimens that consist of a spaced set of absorbers. Despite this, the architectural industry has expressed great demand for a simple "single number" rating for these treatments. Likewise, acoustical consultants desire equivalent absorption coefficient data for use in acoustical modeling software. The following is an attempt to appease these demands until ASTM develops a standard method for calculation. Several alternate non-standard calculation methods are provided. Riverbank Acoustical Laboratories prefers method 1.

Method 1) Apparent Sound Absorption Coefficient calculated from total test surface area covered

The total sound absorption yielded by the specimen is divided by the total surface area of the test surface covered by the suspended baffles, including intermediate spaces. The baffle rigging covered 7.14 m² (76.83 ft²) of horizontal test surface area. With an extra 304.8 mm (12 in.) of width to account for the space between the tested array and what would be the next baffle in a larger array, the surface area comes to 7.88 m² (84.83 ft²) Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This may be the most accurate method for comparing baffle arrays to ceiling tile products. The apparent sound absorption coefficient data can be assigned to a single horizontal surface or plane in acoustical modeling software for approximation of baffle array performance. Such approximations rely on the assumptions that baffle spacing is similar to that of the tested array across the entire surface, that the space between adjacent rows of baffles is negligibly small, and that the installation occurs over a perfectly reflective surface material.

Method 2) Apparent Sound Absorption Coefficient calculated from total exposed surface area of specimen The total sound absorption yielded by the specimen is divided by the total surface area of all exposed specimen faces (1.53 m² (16.45 ft²) per baffle x 10 baffles = 15.29 m² (164.53 ft²) total surface area). Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method shows the actual absorption occurring at the exposed surfaces, but does not provide a fair comparison with materials mounted as a uniform patch (in A-mount or E-mount).

Method 3) Apparent Sound Absorption Coefficient calculated from one face per baffle

The total sound absorption yielded by the specimen is divided by the surface area of one side of one large face for each baffle in the specimen $(0.71 \text{ m}^2 \text{ } (7.67 \text{ ft}^2) \text{ per baffle x } 10 \text{ baffles} = 7.12 \text{ m}^2 \text{ } (76.67 \text{ ft}^2) \text{ total surface area)}.$ Apparent Noise Reduction Coefficient (NRC) rating and Sound Absorption Average (SAA) figures are calculated from this data based on the methods described in ASTM C423-17. This method is favored by some material manufacturers since it yields very high NRC figures, but does not provide a fair comparison with other ceiling tile or wall panel products. Riverbank Acoustical Laboratories recommends that results obtained from this method be used for research and comparison purposes only; such results should not be used for marketed claims of product performance.



An A LION Technical Center

Riverbank Acoustical Laboratories 1512 S. Batavia Ave. Geneva, IL 60134-3302

Tel: 630-232-0104 Fax: 630-232-0138

Email: RAL@alionscience.com

SPONSOR: TURF Report Referenced: RALTM-A20-256

CONDUCTED: 2020-06-26 Page 2 of 2

Appendix D: Data

Note: See full test report for details of mounting position, spacing, and configuration, as these parameters greatly affect sound absorption performance.

			Method 1	Method 2	Method 3
Specimen Absorption		orption	Apparent	Apparent	Apparent
			Abs. Coefficient	Abs. Coefficient	Abs. Coefficient
Freq.			From Total	From Total	From One
(Hz)	Sabins	Sabins / Unit	Coverage Area	Exposed Surface	Face/Baffle
31.5	3.75	0.37	0.04	Area 0.02	0.05
40	-0.98	-0.10	-0.01	-0.01	-0.01
50	0.89	0.09	0.01	0.01	0.01
	4.30	0.09	0.01	0.01	0.01
63	2.35	0.43	0.03	0.03	0.00
80				<u> </u>	
100	4.44	0.44	0.05	0.03	0.06
125	4.03	0.40	0.05	0.02	0.05
160	0.08	0.01	0.00	0.00	0.00
200	0.99	0.10	0.01	0.01	0.01
250	3.54	0.35	0.04	0.02	0.05
315	9.59	0.96	0.11	0.06	0.13
400	12.50	1.25	0.15	0.08	0.16
500	15.30	1.53	0.18	0.09	0.20
630	25.93	2.59	0.31	0.16	0.34
800	38.13	3.81	0.45	0.23	0.50
1,000	56.04	5.60	0.66	0.34	0.73
1,250	83.55	8.36	0.98	0.51	1.09
1,600	102.69	10.27	1.21	0.62	1.34
2,000	119.16	11.92	1.40	0.72	1.55
2,500	127.57	12.76	1.50	0.78	1.66
3,150	125.76	12.58	1.48	0.76	1.64
4,000	125.31	12.53	1.48	0.76	1.63
5,000	124.97	12.50	1.47	0.76	1.63
6,300	121.56	12.16	1.43	0.74	1.59
8,000	119.09	11.91	1.40	0.72	1.55
10,000	117.80	11.78	1.39	0.72	1.54
12,500	114.78	11.48	1.35	0.70	1.50
-,		Apparent NRC:	0.55	0.30	0.65
		Apparent SAA:	0.58	0.30	0.65

Prepared by_

Malcolm Kelly

Test Engineer, Acoustician